
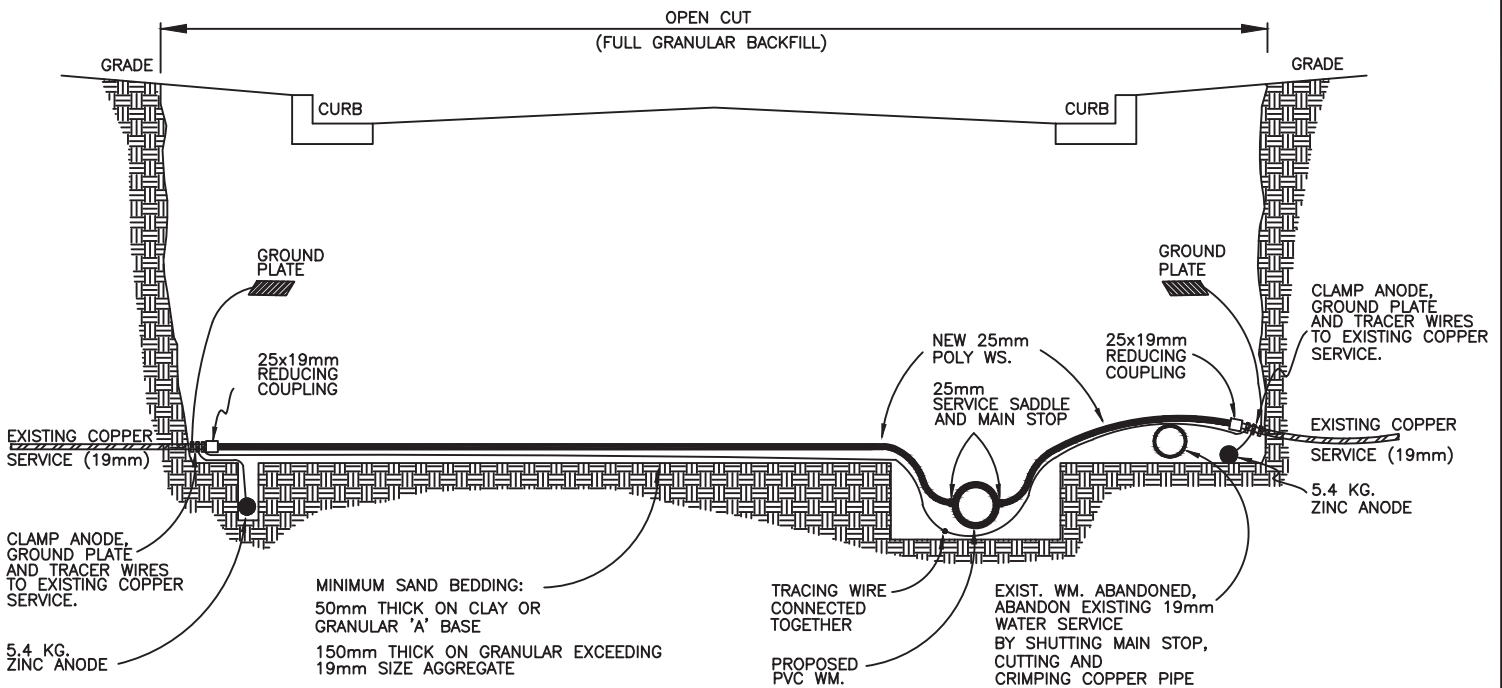


- NOTES:
- MINIMUM 0.6m SAND BEDDING AND BACKFILL ATOP WATER SERVICES
 - FULL GRANULAR BACKFILL TO TOWN OF LASALLE SPECS.
 - CATHODIC PROTECTION TO BE COMPLETED FOLLOWING SECTION 3.8 OF THE DEVELOPMENT MANUAL AND MANUFACTURER'S STANDARDS AND SPECIFICATIONS.
 - STAINLESS STEEL SADDLES TO BE INSTALLED AND TAPS TO BE HORIZONTAL.
 - TRACING WIRE TO BE CONNECTED TO MAIN LINE TRACING WIRE AND EXTENDED AND CLAMPED TO EXIST. COPPER WATER SERVICE PIPE. ALL BRASS CLAMPS AND CONNECTORS TO BE MASTIC WRAPPED.
 - HORIZONTAL GOOSE NECKS TO BE USED.
 - ALL MATERIALS TO MEET TOWN SPECIFICATIONS.
 - SPECIAL ATTENTION MUST BE GIVEN TO COMPLY WITH THE ONTARIO HYDRO INSPECTION CODE.
 - NO WATER SERVICE SHOULD BE CUT WITHOUT FIRST INSTALLING A TEMPORARY JUMPER CONNECTION.

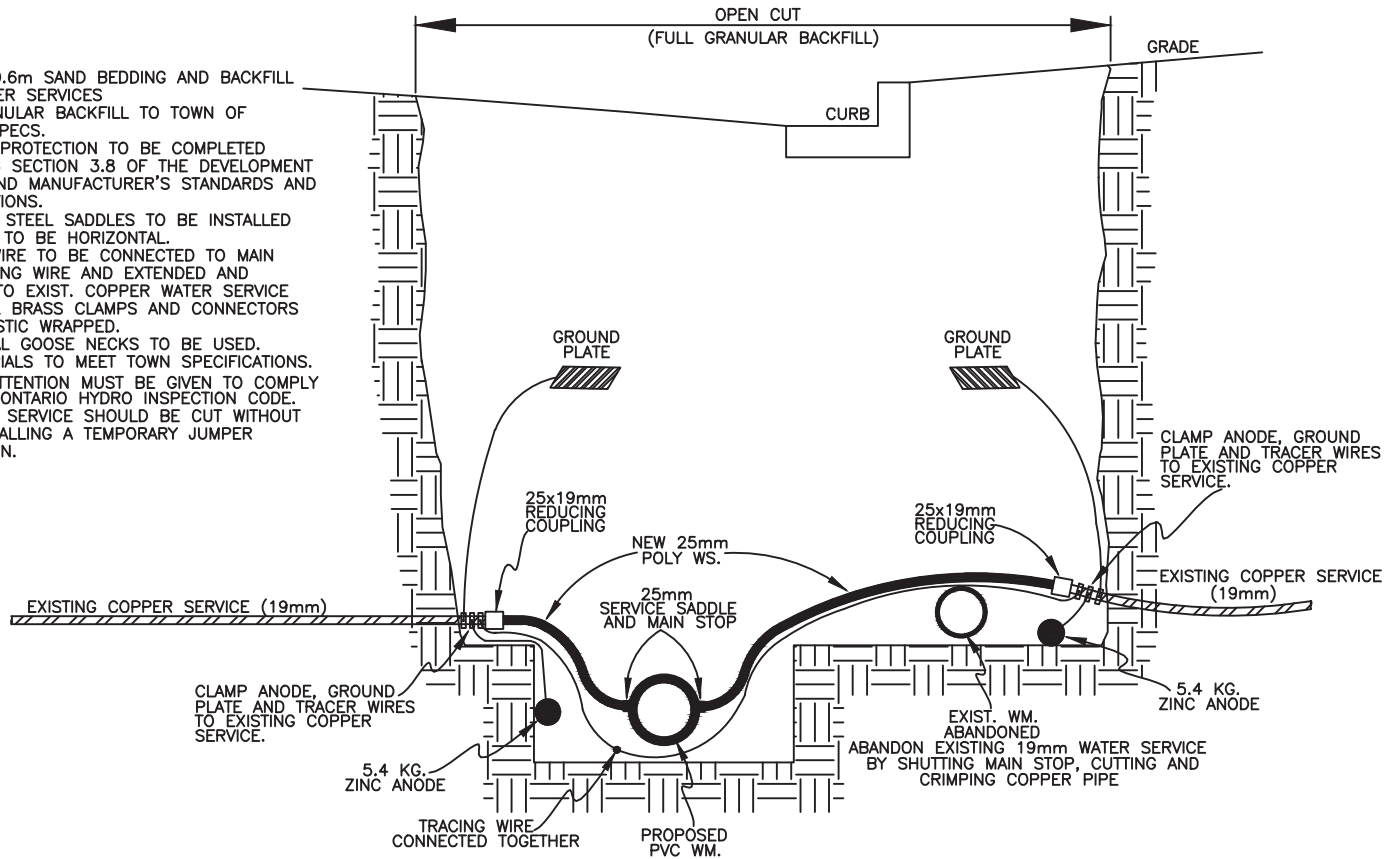

No.	Revision Date	No.	Revision Date
		1	March 18, 2020
			Revision Date